



Developing a Water Management Program to Reduce *Legionella* Growth & Spread in Buildings

A PRACTICAL GUIDE TO IMPLEMENTING
INDUSTRY STANDARDS



Introduction

Legionnaires' disease is a serious type of pneumonia caused by bacteria, called *Legionella*, that live in water. People can get sick when they inhale water containing *Legionella* from building water systems or devices that are not adequately maintained. Legionnaires' disease is on the rise in the United States. To reverse this trend, we are asking for your help to manage the risk of exposure to *Legionella* from water in your building.


Your building may need a water management program to reduce the risk for Legionnaires' disease associated with your building water system and devices. This water management program should identify areas or devices in your building where *Legionella* might grow or spread to people so that you can reduce that risk. *Legionella* water management programs are now an industry standard for large buildings in the United States (ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta).

This toolkit will help you develop and implement a water management program to reduce your building's risk for growing and spreading *Legionella*.

If you already have a program, this toolkit will help you assess and strengthen it. Included are practical resources to help you ensure that your water management program is comprehensive, effective, and in line with industry standards. This toolkit also highlights special considerations for healthcare facilities.

Because building water systems vary in their design and complexity, examples in this toolkit are only meant to help you understand the process. You should develop a water management program to reduce *Legionella* growth and spread that is specific to your building.

Legionnaires' Disease in the United States 2000–2023*

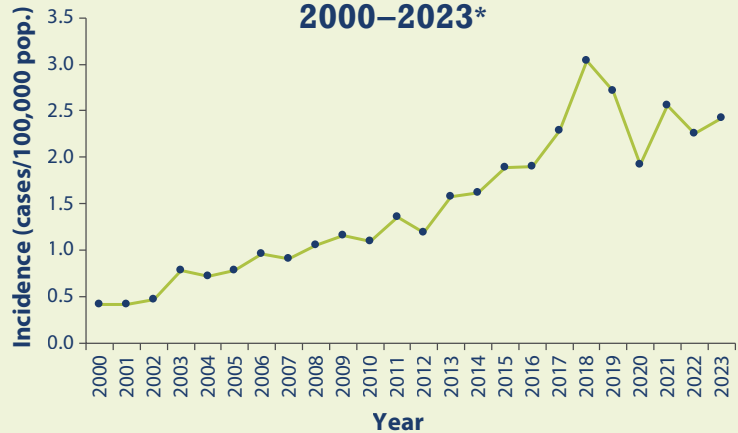

*National Notifiable Diseases Surveillance System

In general, Legionnaires' disease incidence has been increasing since 2000. More illness occurs in the summer and early fall but can happen any time of year.

We welcome your feedback on this toolkit by emailing pneumonia-strep@cdc.gov

For additional information about Legionnaires' disease, visit www.cdc.gov/legionella.

For additional information about controlling *Legionella*, visit: www.cdc.gov/control-legionella

This toolkit can also be found online at www.cdc.gov/control-legionella/php/toolkit/wmp-toolkit.html.

Table of Contents

Introduction	ii
How to Use This Toolkit	1
Identifying Buildings at Increased Risk	3
Glossary	4
Introduction to <i>Legionella</i> Ecology	6
Elements of a Water Management Program	8
Establish a Water Management Program Team	9
Describe Your Building Water Systems Using Text	10
Describe Your Building Water Systems Using a Flow Diagram	12
Identify Areas Where <i>Legionella</i> Could Grow & Spread	13
Control Measures & Corrective Actions: The Basics	14
Decide Where Control Measures Should Be Applied	15
Decide How to Monitor Your Control Measures	16
Corrective Action Examples	17
Examples of Response Activities	20
Make Sure the Program Is Running as Designed & Is Effective	23
Document & Communicate All the Activities of Your Water Management Program	24
Special Considerations for Healthcare Facilities	25
Elements of a Water Management Program	25
Identifying & Investigating Legionnaires' Disease Cases	26
References & Resources	28
Appendix A	31
Appendix B	32
Notes	34



How to Use This Toolkit

If you've never developed a *Legionella* water management program (a plan to reduce the risk of *Legionella* growth and spread), you might not be sure where or how to start. This toolkit will provide guidance to help you develop, implement, and evaluate a *Legionella* water management program for your building. You do not have to have training or certification in any specific hazard analysis, risk assessment, or risk management methodologies to use this toolkit. However, you may need to seek help from an expert in some cases. Be sure to follow all relevant federal, state, and local laws, regulations, and ordinances. If anything in this toolkit conflicts with these policies, always adhere to the policies.

Where do we start?

The first step is to determine if you even need a program. You can use the worksheet on [page 3](#) to find out if your entire building or parts of it are at increased risk for *Legionella* growth and spread. If you learn that you need to develop a program, this toolkit will explain what steps you should take and give several examples to clarify the process.

Do we really need a water management program to prevent *Legionella* growth and spread?

If you answer **YES** to any of the questions on [page 3](#), then yes! Developing and implementing a program means that you are helping to protect people from getting Legionnaires' disease, a serious type of pneumonia (see [Appendix A](#) for more information on this disease).

Is this toolkit full of scientific terms?

You might come across some technical terms that are unfamiliar. The glossary on [page 4–5](#) and the introduction to *Legionella* ecology on [pages 6–7](#) should help you with these terms.

Will this toolkit tell us everything that we need to do?

No. Because every building is unique, only you have access to all the information that is needed to develop and implement a program specific to your building. An example of a building is included to help illustrate some of the steps.

It's important to know that these examples are not comprehensive and you will need to create a program specific to your building water system and devices.

This toolkit looks really long. What's the bottom line?

You need to actively identify and manage hazardous conditions that support growth and spread of *Legionella*. As you work through the toolkit, you'll learn about the importance of identifying and controlling hazardous conditions that increase the chance of *Legionella* growth and spread. The bottom line is that you need to:

- Identify building water systems for which *Legionella* control measures are needed
- Assess how much risk the hazardous conditions in those water systems pose
- Apply control measures to reduce the hazardous conditions, whenever possible, to prevent *Legionella* growth and spread
- Make sure the program is running as designed and is effective

Is there anyone who can help us develop our program?

Yes. As you'll learn in the toolkit, it's recommended that you form a water management team. Your team should include a variety of people who bring different skills to the table (learn more on [page 9](#)). You might already have all the expertise you need on staff, but sometimes you will need to get outside help. In some cases, you may need to train your in-house personnel or hire professionals with specific experience in *Legionella* bacteria in building water systems, such as a certified industrial hygienist, a microbiologist, or an environmental health specialist. Blueprints could come in handy, too.

What do all of the gray boxes mean?

The gray boxes throughout the document highlight program elements that are especially relevant for healthcare facilities. The content found outside of the gray boxes is also applicable to these types of facilities.



Identifying Buildings at Increased Risk

Survey your building (or property) to determine if you need a water management program to reduce the risk of *Legionella* growth and spread.

If you answer **YES to any of questions 1 through 4, you should have a water management program for *that building's* hot and cold water distribution system.**

Healthcare Facilities

- Yes ____ No ____ 1. Is your building a healthcare facility where patients stay overnight or does your building house or treat people who have chronic and acute medical problems[†] or weakened immune systems?
- Yes ____ No ____ 2. Does your building primarily house people older than 65 years (like a retirement home or assisted-living facility)?
- Yes ____ No ____ 3. Does your building have multiple housing units and a centralized hot water system (like a hotel or high-rise apartment complex)?
- Yes ____ No ____ 4. Does your building have more than 10 stories (including basement levels)?

Devices in buildings that can spread water droplets containing *Legionella* should have a water management program even if the building itself does not. If you answer **NO to all of questions 1 through 4 but **YES** to any of questions 5 through 8, you should have a water management program for *that device*.**

- Yes ____ No ____ 5. Does your building have a cooling tower*?
- Yes ____ No ____ 6. Does your building have a hot tub (also known as a spa) that is not drained between each use?
- Yes ____ No ____ 7. Does your building have a decorative fountain?
- Yes ____ No ____ 8. Does your building have a centrally-installed mister, atomizer, air washer, or humidifier?

If you answer **NO to questions 1 through 8, you should still maintain water systems according to manufacturer recommendations.**

On properties with multiple buildings, prioritize buildings that house or treat people who are at increased risk for Legionnaires' disease (see [Appendix A](#) to learn who is at increased risk).

The building standards discussed in this toolkit do not apply to single-family or small multiple-family residences (e.g., duplexes), even those with the devices in questions 6 through 8, but residents do need to take steps to protect themselves from waterborne diseases.

Homeowners should follow local and state guidelines for household water use, and owners of the devices in questions 6 through 8 should follow the manufacturer's instructions regarding cleaning, disinfecting, and maintenance.

Resource: [Preventing Waterborne Germs at Home](#)

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

[†]Burns, cancer, solid organ or bone marrow transplant, kidney disease, diabetes, or chronic lung disease

*For an illustration of a cooling tower, visit www.cdc.gov/legionella/communication-resources/cooling-tower-illustration.html.

Glossary

Biofilm: Germs and the slime they secrete that stick to and grow on any continually moist surface; provides a stable growth surface and an environment with nutrients for many types of germs, including *Legionella*

Building water systems: Includes hot and cold water distribution systems and all devices that use water to which people can be exposed, such as hot tubs, decorative fountains, and cooling towers

Control: To manage conditions within the building according to a water management program or to maintain established criteria

Control limits: The maximum value, minimum value, or range of values that are acceptable for the control measures that you are monitoring to reduce the risk for *Legionella* growth and spread

Control measures: Actions that can be taken for building water systems to limit growth and spread of *Legionella*, such as heating, adding disinfectant, or cleaning; control measures enable maintenance of control limits

Control points: Locations in the water systems where a control measure can be applied

Corrective action: Actions taken to reestablish control when monitoring or measurement values are outside control limits

Dead legs: Piping subject to low or no flow because of design or decreased water use; for example, capped pipes or unused faucets

Disinfectant: Chemical or physical treatment to kill germs; for example, chlorine, monochloramine, chlorine dioxide, bromine compounds, copper-silver ionization, ultraviolet light, or ozone

Disinfectant residual: Amount of disinfectant available in water to kill bacteria

Hazardous conditions: Any condition or factor that can contribute to the growth and spread of *Legionella* to a person if not controlled

Healthcare facility: Hospitals, long-term care facilities, clinics, or other settings where patients seek care, such as dental offices, pharmacies, or outpatient laboratories

***Legionella*:** Bacteria that can cause Legionnaires' disease

Legionnaires' disease: A serious type of pneumonia caused by *Legionella*

Nonroutine *Legionella* testing: Testing for *Legionella* to investigate potential sources of environmental exposure for persons with disease. Testing for public health investigations should always be performed in conjunction with the public health authority having jurisdiction

People at increased risk for Legionnaires' disease: Includes people 50 years or older, current or former smokers, people with a chronic lung disease (like emphysema), people with weak immune systems or who take drugs that weaken the immune system, people with cancer, and people with underlying illnesses such as diabetes, kidney failure, or liver failure

Potable water: Hot or cold water intended for people to drink or ingest, such as drinking, bathing, food preparation, and dishwashing

Remediation: Response activities taken to reduce colonization in response to control measures, such as routine *Legionella* test results, that persistently exceed control limits or to events that pose an immediate risk to control of building water systems; required whenever Legionnaires' disease occurs; may also be appropriate for unexpected events such as equipment failure or acts of nature that disrupt the water system

Response Activities: Reaction to control measures that are persistently outside of control limits or events that pose an immediate risk to control of your building water systems; required for all instances when Legionnaires' disease occurs, but may also be appropriate for unexpected events such as equipment failure or acts of nature that disrupt the water system

Routine *Legionella* testing: Testing for *Legionella* to establish a baseline measurement for performance indicators or for validating a water management program or corrective action. Methods and objectives vary from those of nonroutine *Legionella* testing

Scale and sediment: Mineral build-up in a water system that uses up disinfectant and supports growth or survival of bacteria


Stagnation: When water does not flow well; areas of stagnation encourage biofilm growth and reduce temperature and level of disinfectant

Validation: Activities to confirm the water management program is working as intended and is effective for *Legionella* control; testing for *Legionella* is one method for validation of a water management program

Verification: Activities to confirm the water management program procedures are occurring as intended; reviewing temperature logs to ensure temperature measurement is occurring at the intended frequency is one method for verification of a water management program



Introduction to *Legionella* Ecology

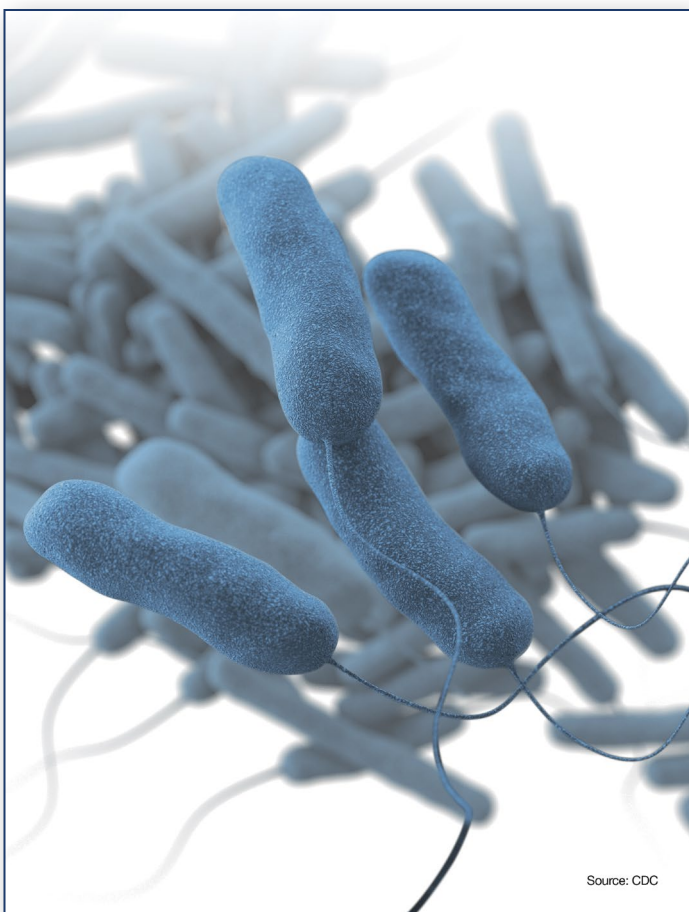

Source: CDC

Legionella pneumophila

Legionella is found naturally in freshwater environments, like lakes and streams, but generally the low amounts in freshwater do not lead to disease. *Legionella* can become a health problem in building water systems. To pose a health risk, *Legionella* first has to **grow** (increase in numbers). Then it has to be **aerosolized** so people can breathe in small water droplets containing *Legionella*. Less commonly, people can get sick when they aspirate water (when water accidentally goes into the lungs while drinking).

Where can *Legionella* grow and/or spread?

Legionella can grow in many parts of building water systems that are wet, and certain devices can then spread water droplets containing *Legionella*. Examples include:

- Hot and cold water storage tanks
- Water heaters
- Water-hammer arrestors
- Expansion tanks
- Water filters
- Electronic and manual faucets*
- Aerators
- Faucet flow restrictors
- Showerheads* and hoses
- Pipes, valves, and fittings
- Centrally-installed misters*, atomizers*, air washers*, and humidifiers*
- Nonsteam aerosol-generating humidifiers*
- Infrequently used equipment, including eyewash stations*
- Ice machines*
- Hot tubs*
- Decorative fountains*
- Cooling towers*
- **Medical devices* (such as CPAP machines, hydrotherapy equipment, bronchoscopes)**

*These devices can spread *Legionella* through aerosols or aspiration

Factors external to buildings that can lead to *Legionella* growth

- **Construction:** Vibrations and changes in water pressure can dislodge biofilm and free *Legionella* into the water entering your building.
- **Water main breaks:** Changes in water pressure can dislodge biofilm and free *Legionella* into the water, while dirt and other materials can be introduced into the water and use up disinfectant.
- **Changes in municipal water quality:** Changes in water quality can increase sediment, lower disinfectant levels, increase turbidity, or cause pH to be outside recommended ranges. Changes in disinfectant type can impact how you should monitor your program.

Factors internal to buildings that can lead to *Legionella* growth

- **Biofilm:** Protects *Legionella* from heat and disinfectant; provides food and shelter to germs; grows on any surface that is constantly moist and can last for decades
- **Scale and sediment:** Uses up disinfectant and creates a protected home for *Legionella* and other germs
- **Water temperature fluctuations:** Provide conditions where *Legionella* grows best (77°F–113°F); *Legionella* can still grow outside this range
- **Water pressure changes:** Can cause biofilm to dislodge, colonizing downstream devices
- **pH:** Disinfectants are most effective within a narrow range (approximately 6.5 to 8.5).


Many things can cause the hot water temperature to drop into the range where *Legionella* can grow, including low settings on water heaters, heat loss as water travels through long pipes away from the heat source, mixing cold and hot water within the plumbing system, heat transfer (when cold and hot water pipes are too close together), or heat loss due to water stagnation. In hot weather, cold water in pipes can heat up into this range.

- **Inadequate disinfectant:** Does not kill or inactivate *Legionella*.
Even if the water entering your building is of high quality, it may contain *Legionella*. In some buildings, processes such as heating, storing, and filtering can degrade the quality of the water. These processes use up the disinfectant the water entered with, allowing the few *Legionella* that entered to grow into a large number if not controlled.
- **Water stagnation:** Encourages biofilm growth and reduces temperature and levels of disinfectant.
Common issues that contribute to water stagnation include renovations that lead to ‘dead legs’ and reduced building occupancy, which can occur in hotels during off-peak seasons, for example. Stagnation can also occur when fixtures go unused, like a rarely used shower in a hospital room.



Elements of a Water Management Program

Developing and maintaining a water management program is a multi-step, continuous process. The key steps, listed here, are explained in more detail throughout the toolkit with the associated step number appearing on the page where the specific step is discussed.

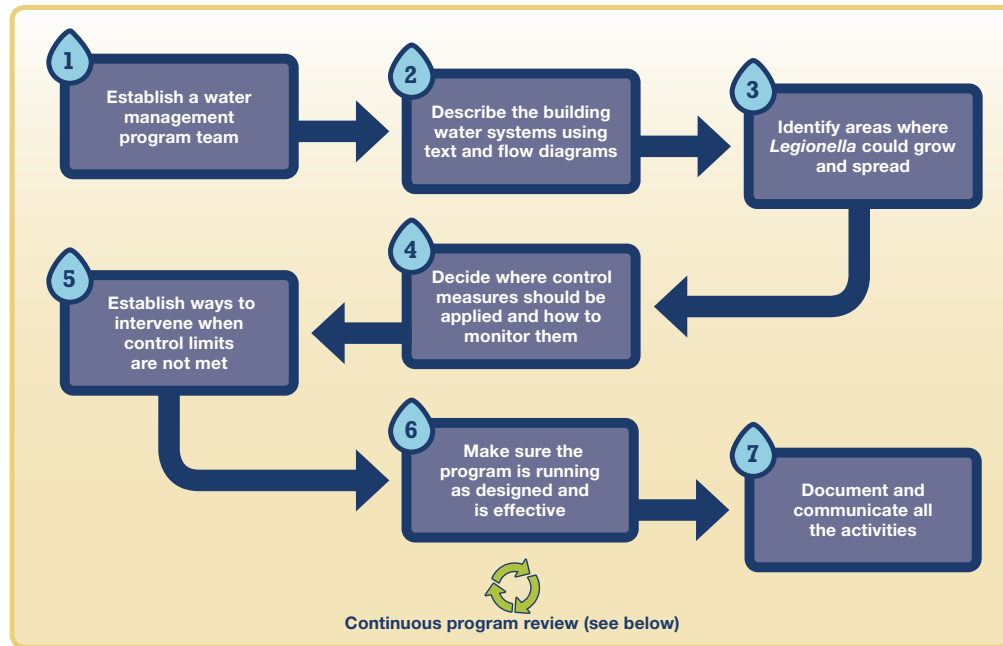

Program Review

You need to **review** the elements of your program at least once per year. Make sure you also review and revise your program when any of the following events occur:

- Data review shows control measures are persistently outside of control limits
- A major maintenance or water service change occurs, such as:
 - New construction
 - Equipment changes (e.g., new hot tub chlorinator pump)
 - Changes in treatment products (e.g., disinfectants)
 - Changes in water usage (e.g., high and low season for hotel)
 - Changes in the municipal water supply
- One or more cases of disease are thought to be associated with your system(s)
- Changes occur in applicable laws, regulations, standards, or guidelines

If an event triggers you to review and update your water management program, remember to:

- Update the process flow diagram, associated control points, control limits, and corrective actions
- Update the written description of your building water systems
- Train those responsible for implementing and monitoring the updated program

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
 ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Establish a Water Management Program Team

Certain skills, described in the diagram below, are needed to develop and implement your water management program. These skills would typically be provided by a combination of people, some of whom may have multiple skills (examples shown below).



Consider who among your employees, partners, and outside experts can provide these skills so that you can develop the most effective program possible. Those who might be part of your water management program team include:

- Building owner
- Building manager/administrator
- Maintenance or engineering employees
- Safety officers
- Equipment or chemical suppliers
- Contractors/consultants (e.g., water treatment professionals)
- Certified industrial hygienists
- Microbiologists
- Environmental health specialists
- State and local health officials

Healthcare Facilities

The team should also include:

- Someone who understands accreditation standards and licensing requirements
- Someone with expertise in infection prevention
- A clinician with expertise in infectious diseases
- Risk and quality management staff

In some cases, you may need to train your in-house personnel or hire professionals with specific experience in *Legionella* bacteria in building water systems.



2

Describe Your Building Water Systems Using Text

EXAMPLE: BUILDING A

You will need to write a simple description of your building water system and devices you answered YES to on [page 3](#). This description should include details like where the building connects to the municipal water supply, how water is distributed, and where pools, hot tubs, cooling towers, and water heaters or boilers are located. An existing as-built diagram of the plumbing system and fixtures may be useful in developing this description. Below is a description of the water systems* for an example building (Building A). You will see how this text gets turned into a diagram in the next section ([page 12](#)).

1. **Water enters** the basement of the property via a 4-inch main from the municipal water line at Maple Street. Water is immediately drawn off to charge the fire suppression system. The rest of the water is sent through cold water distribution. There is backflow prevention throughout the system, including between the cold water distribution and the city water main and between the cold water distribution and the fire suppression system.

Note: *Problems with entering water are usually beyond the building manager's control, such as main breaks or construction that disrupts water service. However, an essential part of a water management program is monitoring water and responding to changes coming in from the municipal water line. You can contact your drinking water provider to report any changes you notice in the quality of water being delivered to your building.*

2. **Cold water is distributed** directly to the lit decorative fountain in the lobby, the cooling tower on the roof, the hot tub and pool on the first floor, ice machines on floors 2, 4, 6, 8, and 10, and shower and faucet fixtures in rooms on all 12 floors. All internal plumbing consists of 2-inch copper and polyvinyl chloride (PVC) piping. There is backflow prevention between cold water distribution and the utility lines that serve the cooling tower and hot tub/pool room.

Note: *In warm climates, water in pipes that typically carry cold water may reach a temperature that allows for growth of Legionella. Detectable residual disinfectant added by your water provider helps to limit growth of Legionella and other germs. Additionally, decorative fountains with submerged lighting and devices such as cooling towers and ice machines may contain areas where cold water can be heated to temperatures that allow Legionella to grow. Swimming pools do not usually generate hazardous conditions because they rarely reach adequate temperature for growth or generate water droplets small enough to be inhaled.*

3. **Cold water is heated** to 140°F by two joined 120-gallon water heaters. The heaters supply a 500-gallon storage tank. Cold water is also delivered to an 80-gallon water heater in the basement that serves the kitchen and staff break room.

Note: *Even water heaters set to the correct temperature may contain zones of lower temperature water where cold and hot water mix or where excessive sediment blocks heating elements. Most residual disinfectants are reduced by heating the water.*

Healthcare Facilities

Be sure to include descriptions of water sources relevant to:

- Patient care areas
- Clinical support areas
- Components and devices that can expose patients to water containing *Legionella*

You should also develop an ongoing dialogue with your drinking water provider so that you are aware of changes that may affect your building's water supply.

* Examples of water systems not included in Building A that may be of concern include, but are not limited to, recycled or reused water, eyewash stations, and solar water heaters.

Disclaimer: *Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.*

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

4. **Hot water is distributed** to plumbing fixtures in the basement through floor 5 from the joined water heaters in the basement on a direct (non-recirculating) line. Hot water is distributed to floors 6 through 11 from the storage tank with a recirculating line designed to return to the joined water heaters in the basement. Note that hot water is tempered (mixed with cold water) at the fixtures by thermostatic mixing valves.

Note: *Water in direct hot and cold water pipes can pose multiple hazardous conditions. First, the process of heating the water can reduce disinfectant levels. Second, if hot water is allowed to sit in the pipes (stagnation), it might reach a temperature where Legionella can grow and could encourage sediment to accumulate or biofilm to form. With recirculating hot water pipes, the greatest risk is that returning water with reduced or no disinfectant cools to a temperature where Legionella can grow. Legionella in the return lines can travel to central distribution points where it can be further disseminated throughout the building water system.*

5. **Hot, cold, and tempered waste water is discarded** through the sanitary sewer line.



Disclaimer: *Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.*


References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

2

Describe Your Building Water Systems Using a Flow Diagram

EXAMPLE: BUILDING A

In addition to developing a written description of your building water systems, you should develop a process flow diagram. Below is an example of a process flow diagram for Building A. Note that this diagram does not need to be as detailed as your building plans. In fact, it's best if the process flow diagram can be understood easily by all members of your team.

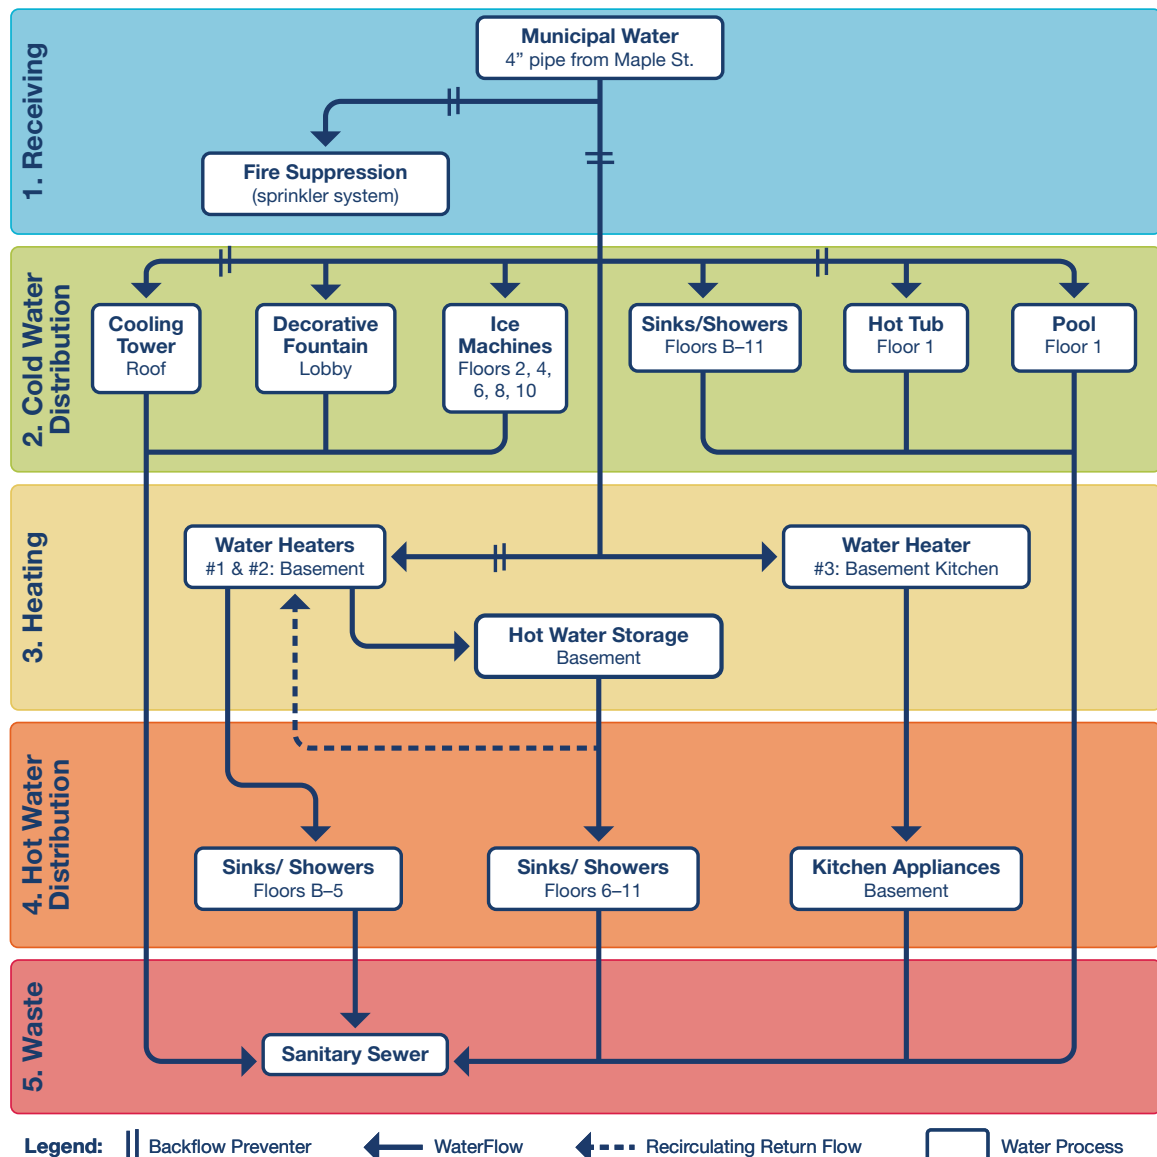


Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
 ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Identify Areas Where *Legionella* Could Grow & Spread

EXAMPLE: BUILDING A

Once you have developed your process flow diagram, identify where potentially hazardous conditions could occur in your building water systems. The below diagram points out locations and types of hazardous conditions you could expect in Building A. Each potentially hazardous condition should be addressed individually with a control point, measure, and limit.

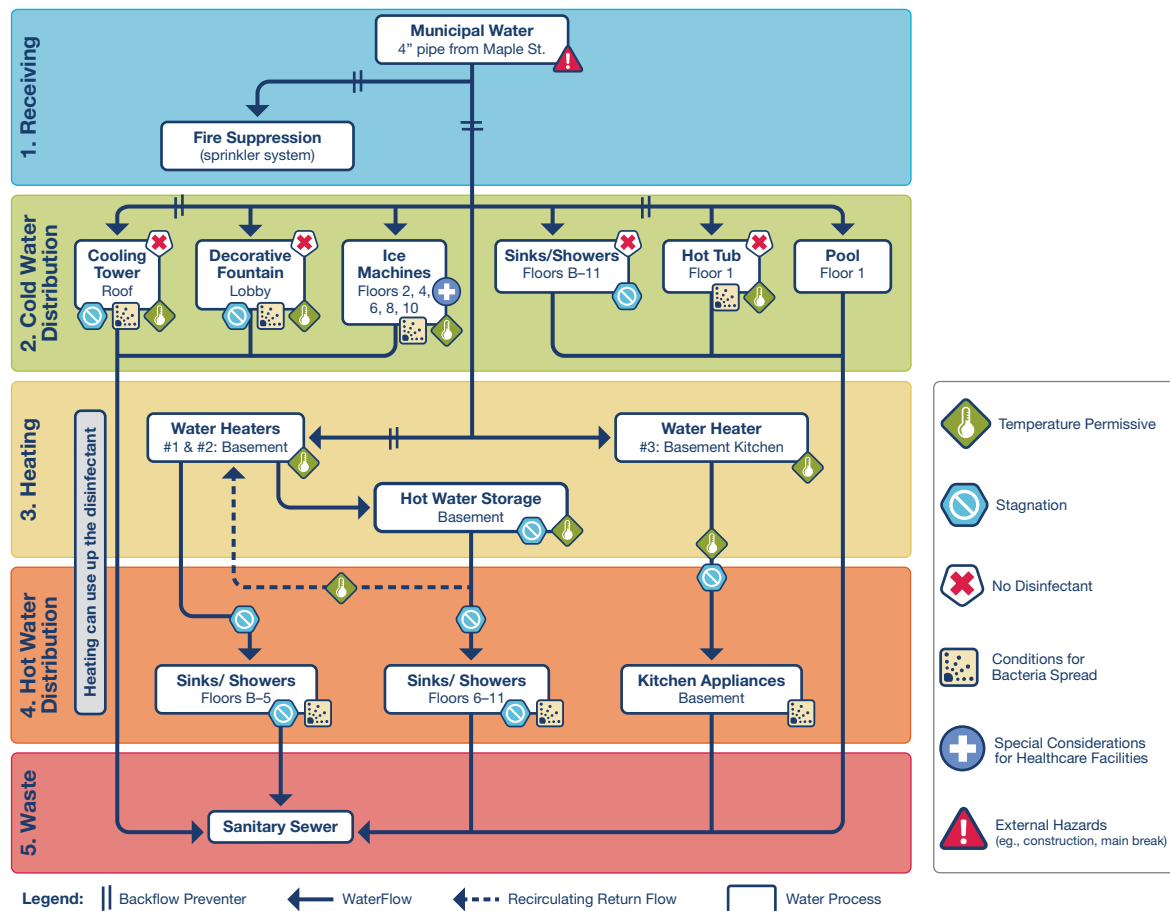

Healthcare Facilities

Think about:

- Areas where medical procedures may expose patients to water droplets, such as hydrotherapy
- Areas where patients are more vulnerable to infection, such as bone marrow transplant units, oncology floors, or intensive care units

In Building A, the ice machine is included to illustrate that patients with problems swallowing may be at increased risk for *Legionella* spread by aspiration.


Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

3

Control Measures & Corrective Actions: The Basics

The diagram below shows the process of implementing and monitoring control measures. If you find that a control limit (i.e., temperature levels, disinfectant levels) is not being met, you need to take corrective actions to get conditions back to within an acceptable range. The right side, in yellow, illustrates the routine process of monitoring control measures to make sure they are within limits. The left side, in orange, shows the process of what to do if control measures are found to be outside of their limits.

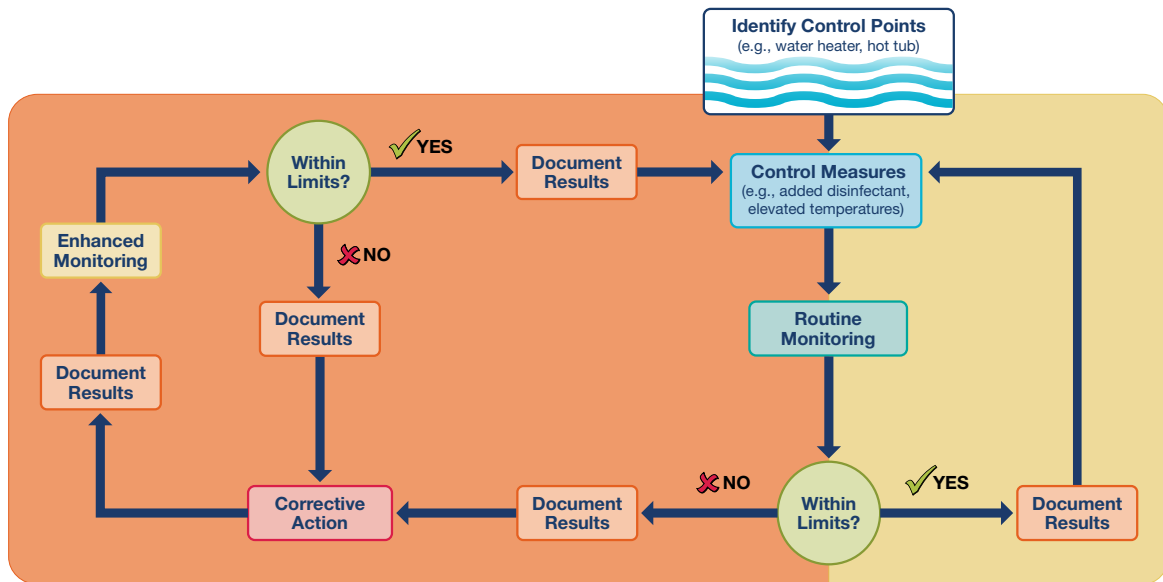

Remember, any time there is a suspected case of Legionnaires' disease associated with your building you should:

- Contact your local and/or state health department or work with them if they contact you
- Notify anyone who could be affected by the growth and spread of *Legionella* in your building if the health department asks you to
- Remediate the building water systems if necessary (you may need to get additional help from outside experts)
- Review the water management program and revise it, if necessary

Healthcare Facilities

In addition to the steps listed above that you would take in all buildings, if a case of healthcare-associated Legionnaires' disease is discovered in a healthcare facility:

- Make sure the person with expertise in infection prevention on your team is aware
- **Important:** Tell clinicians so they can test patients with healthcare-associated pneumonia for Legionnaires' disease with molecular testing or culture of lower respiratory secretions and the *Legionella* urinary antigen test
- Report the case to your local and/or state health department; a full investigation may be needed

For more details on identifying and investigating Legionnaires' disease cases in healthcare facilities, see [page 26](#).

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Decide Where Control Measures Should Be Applied

Control measures and limits should be established for each control point. See the diagram on the next page for the types of monitoring that could occur in Building A. You will need to monitor to ensure your control measures are performing as designed. Control limits, in which a chemical or physical parameter must be maintained, should include a minimum and a maximum value.

Examples of chemical and physical control measures and limits to reduce the risk of *Legionella* growth:

- Water quality should be measured throughout the system to ensure that changes that may lead to *Legionella* growth (such as a drop in chlorine levels) are not occurring.
- Water heaters should be maintained at appropriate temperatures.
- Decorative fountains should be kept free of debris and visible biofilm. Decorative fountains should not be operated in areas intended for use by persons at increased risk of Legionnaires' disease, such as **healthcare facilities**.
- Disinfectant and other chemical levels in cooling towers and hot tubs should be continuously maintained and regularly monitored. Surfaces with any visible biofilm (i.e., slime) should be cleaned.

Healthcare Facilities

Clinicians should test patients with healthcare-associated pneumonia (pneumonia with onset ≥ 48 hours after admission) for Legionnaires' disease. This is especially important among patients at increased risk for developing Legionnaires' disease (see [Appendix B](#)), among patients with severe pneumonia (particularly those requiring intensive care), or if any of the following are identified in your facility:

- Other patients with healthcare-associated Legionnaires' disease diagnosed in the past 12 months
- Positive environmental tests for *Legionella* in the past 2 months
- Current changes in water quality that may lead to *Legionella* growth (such as low chlorine levels)

The preferred diagnostic tests for Legionnaires' disease are molecular testing or culture of lower respiratory secretions on selective media and the *Legionella* urinary antigen test.

Additionally, certain commonly-encountered changes in building water system design or management might require increasing the extent and frequency of monitoring. It's a good idea to anticipate additional hazardous conditions that could be associated with scheduled or unanticipated changes in water quality, such as:

- System start up
- System shut down
- Regularly scheduled maintenance
- Renovations, construction, and installation of new equipment on your property
- Equipment failure
- Water main break or other service interruptions

Anti-scald Regulation

You should follow local and state anti-scald regulations. However, maximum temperatures allowed by your state may be too low to limit *Legionella* growth. Engineering controls that mix hot and cold water together at or near the point of use can reduce the risk of scalding while allowing water in pipes to remain hot enough to limit *Legionella* growth.




4

Decide How to Monitor Your Control Measures

EXAMPLE: BUILDING A

The diagram below shows which types of monitoring could occur at different locations within Building A's water system to reduce the risk of growth and spread of *Legionella*.

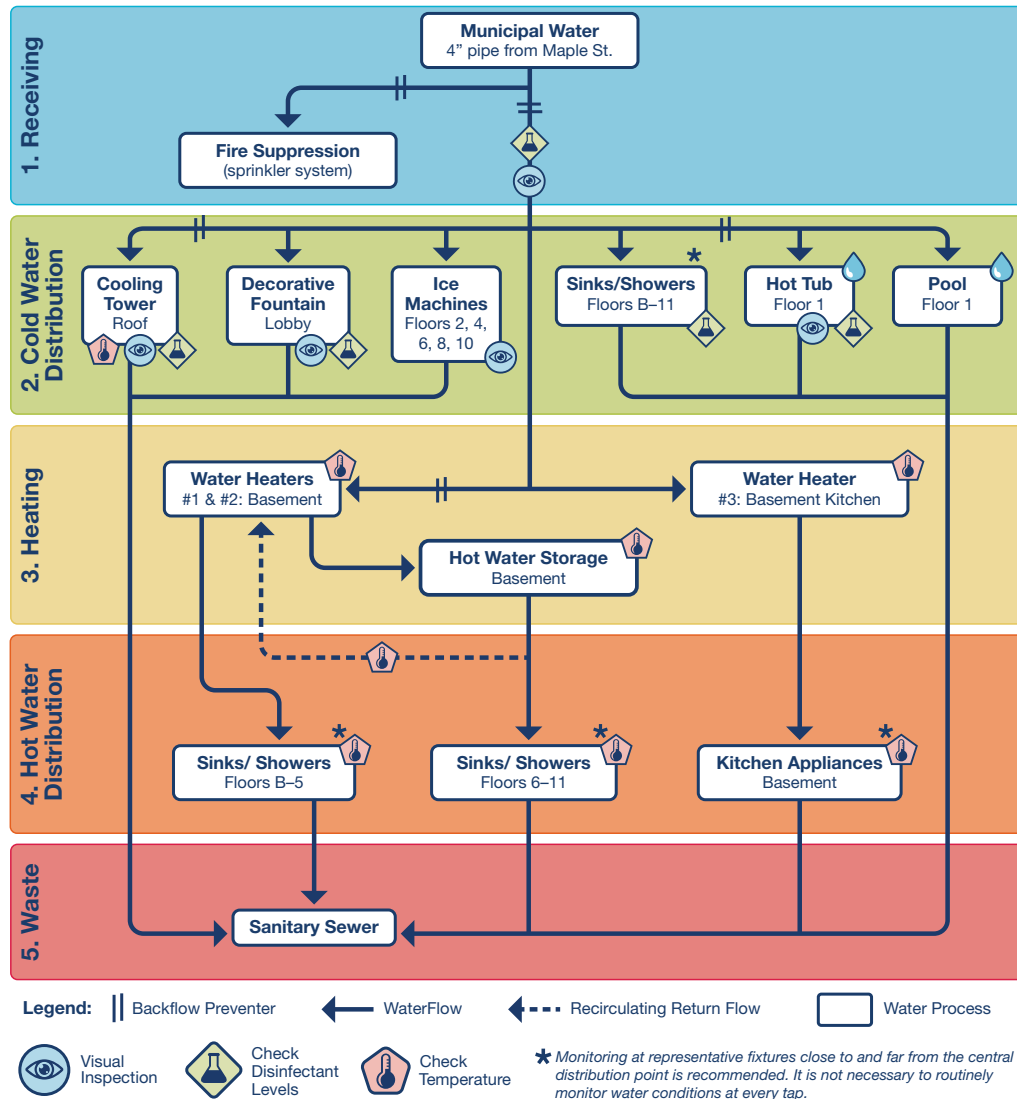

Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org



Note: In addition to whatever you do to prevent *Legionella*, state and local regulations may exist that govern the design, construction, operation, and maintenance of public aquatic facilities (e.g., pools and hot tubs). See CDC's Model Aquatic Health Code at www.cdc.gov/model-aquatic-health-code/php/about/index.html for helpful information, but this document is not a substitute for state and local regulations.

Establish Ways to Intervene When Control Limits Are Not Met

5

CORRECTIVE ACTION EXAMPLES

Building water systems are dynamic. You should plan for your monitoring results to vary over time and be prepared to apply corrective actions. **Corrective actions** are taken in response to systems performing outside of control limits. The following are examples of corrective actions.

Example 1—Biofilm growth in the decorative fountain



1. During her weekly inspection of the fountain in the first floor lobby, Michelle Patterson notes that the fountain walls have accumulated a slimy growth.



2. As dictated by her water management program, Michelle immediately shuts off the fountain, drains it to the sanitary sewer, and scrubs it with a detergent recommended by the manufacturer.



3. She then follows the program's start up procedure to refill the fountain with water and checks the residual disinfectant levels to make sure that they are within control limits.




4. Michelle documents her observations and the performance of interim cleaning in her log book. She informs her supervisor.

Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.


References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

5

Example 2—Unoccupied floor

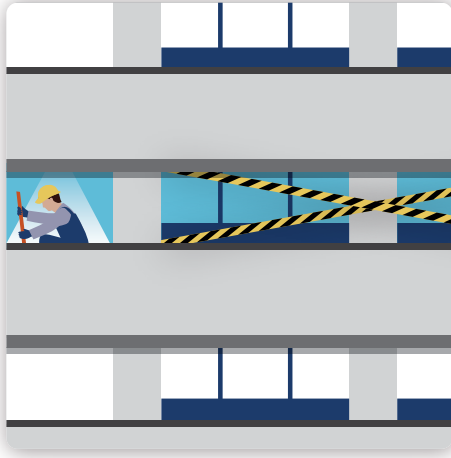

1. The eighth floor of the building is being renovated and is closed to the public. Jason Hernandez understands that this may cause a temporary hazardous condition because water usage will decrease, which means that stagnation is possible.

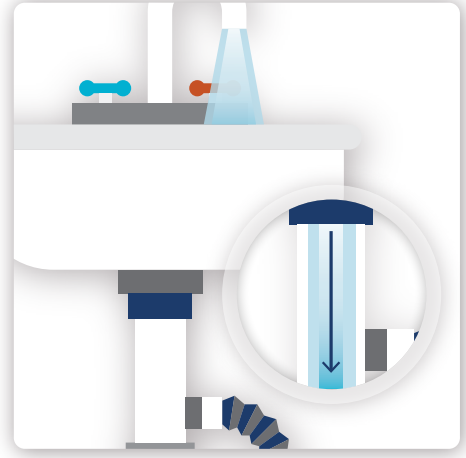

2. After discussing the issue with his supervisor, Jason counteracts the potential for stagnation by daily flushing of the sinks and fixtures with hot and cold water in several rooms including those at the end of the hall, which are farthest from the vertical pipe serving that floor (riser).



3. Jason also increases the frequency of measuring temperature and chlorine levels on the eighth floor from weekly to daily for the duration of the renovation.



4. He documents the method and duration of flushing and records his daily temperature and chlorine readings in his log book. He reviews his documentation with his supervisor.

Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
 ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Example 3—Debris in the cooling tower



1. During weekly inspection of the cooling tower, Michelle discovers that leaf litter has accumulated in the reservoir.



2. Upon further investigation, she finds that a panel has become dislodged, allowing windblown debris to enter.



3. After replacing the panel and skimming out the debris, Michelle checks the disinfectant levels.



4. She documents her actions in her log book. She also makes a note to check the disinfectant levels daily for a week to make sure that the cooling tower remains within control limits. She reviews her actions and documentation with her supervisor.

Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org



5

EXAMPLES OF RESPONSE ACTIVITIES


Even the most closely monitored systems will sometimes require adjustments, as shown in the following examples. You should be prepared to respond, even to unexpected problems, based on your knowledge of the building water systems and how *Legionella* grows and spreads. You may need to initiate response activities to gain control of a building water system. **Response activities** may involve several steps and often require follow up. Response activities are always required when a case of Legionnaires' disease has been linked to a building and is also appropriate in other situations.

Example 1—Biofilm growth in the fountain

1. During the annual review of the water management program, supervisor Anson Cho notes that Michelle and Jason performed six interim cleanings of the lobby fountain due to excessive biofilm growth in the past year.



2. Upon further review of the logs, he discovers that the biofilm growth was observed near the inner wall where incandescent lighting illuminates the water.

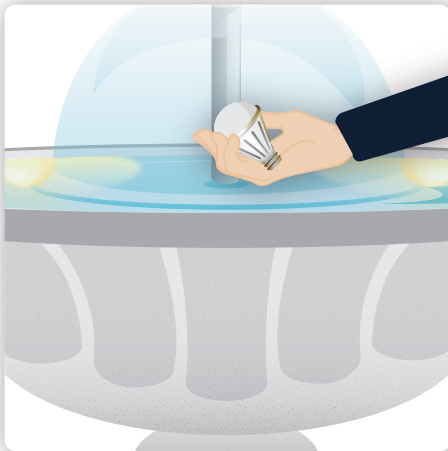

3. Anson decides to replace the incandescent bulbs with LED bulbs to prevent the lights from heating the water to a temperature that allows biofilm to grow.



4. After three months of routine inspections show that this corrective action reduces biofilm growth and eliminates the need for interim cleaning, Anson amends the water management program to specify use of only LED bulbs in the fountain and he informs the owner.


Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
 ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Example 2—Water main break



1. Jason receives several complaints from building occupants of foul-tasting water. He also notes a brownish tint to the water entering the building during his daily visual inspection. Jason immediately contacts the water provider and discovers that there was a water main break nearby but that a boil water advisory was not issued. He sends a notice to building occupants about the main break and that they should limit water usage for the next 4 hours while facilities clear the line.

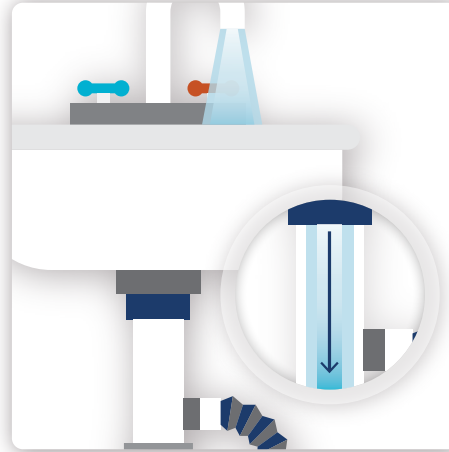

2. To improve building water quality, Jason flushes the water at multiple sinks and fixtures near the entry until the water runs clear and falls within established water quality parameter control limits. He also flushes fixtures in areas where he received taste and odor complaints and at pre-determined flushing locations per the water management program.



3. Jason increases the frequency of measuring chlorine levels at the taps from weekly to daily to ensure that adequate residual disinfectant is moving through the system.



4. Jason informs his supervisor, documents his actions, and records chlorine readings in his log book.

Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org




5

Example 3—Broken chlorinator in the hot tub

1. Michelle notes chlorine levels of zero within the hot tub during her daily inspection. On further inspection she notices that disinfectant in the automatic delivery system reservoir is full.



2. Michelle immediately closes the hot tub and calls the pool contractor.

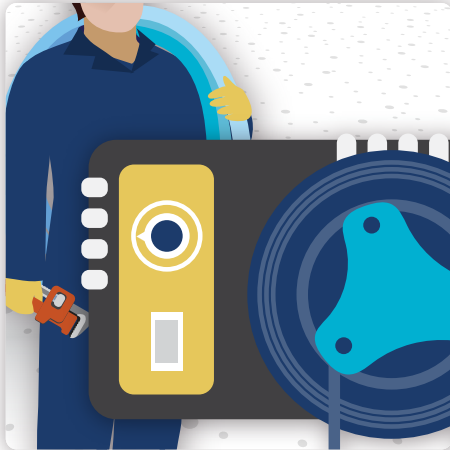

3. The contractor arrives the next day to discover that the chlorinator pump has malfunctioned and replaces the unit.



4. Michelle documents the action and follows the water management program's protocol for start up, which includes cleaning the hot tub, shocking it with a high dose of disinfectant, and back-flushing the filter. Michelle also recommends that the supervisor amend the water management program to include a daily check of equipment operation and disinfectant levels in the reservoir, in addition to the daily visual inspection and chlorine measurements, so that such equipment failures may be detected more quickly in the future.

Disclaimer: Example content is provided for illustrative purposes only and is not intended to be relevant to all buildings.

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Make Sure the Program Is Running as Designed & Is Effective

6

Verification: Are we doing what we said we would do?

Your program team should establish procedures to confirm, both initially and on an ongoing basis, that the water management program is being implemented as designed. This step is called “verification.” For example, if you said you would test the hot tub daily for chlorine and record and communicate those results, have you been doing that? If you found a problem, did you take the action included in your program?

People should not verify the program activity for which they are responsible. For example, if one person is responsible for maintaining the hot tub and another is responsible for the cooling tower, they could verify each other’s work, not their own.

Validation: Is our program actually working?

Now that you have a water management program, you need to be sure that it is effective. Your program team should establish procedures to confirm, both initially and on an ongoing basis, that the water management program effectively controls the hazardous conditions throughout the building water systems. This step is called “validation.”

Environmental testing for *Legionella* is useful to validate the effectiveness of control measures. The program team should determine if environmental testing for *Legionella* should be performed and, if so, how test results will be used to validate the program. Factors that might make testing for *Legionella* more important include:

- Having difficulty maintaining the building water systems within control limits
- Having a prior history of Legionnaires’ disease associated with the building water systems
- Being a facility that houses or provides services to people who are at increased risk for Legionnaires’ disease, such as senior living facilities (see [Appendix B](#))

If the program team decides to test for *Legionella*, then the testing protocol should be specified and documented in advance. You should also be familiar with and adhere to local and state regulations and accreditation standards for this testing.

Healthcare Facilities

Water management program teams that include infection control staff may also choose to use their facility’s routine surveillance for healthcare-associated Legionnaires’ disease to supplement validation efforts for their program. To look for healthcare-associated cases, histories for all patients with diagnosed Legionnaires’ disease should be reviewed for possible healthcare exposures and certain patients with healthcare-associated pneumonia (see the *Healthcare Facilities* section on [page 15](#)) should be tested for Legionnaires’ disease.

The best method for validation of a WMP for *Legionella* is routine testing for *Legionella* over time. Testing for *Legionella* can provide critical information to ensure a WMP is operating as intended and *Legionella* is well controlled.

Because of the vulnerable population served, inpatient healthcare facilities should conduct routine testing for *Legionella* to validate their WMP. Other facilities serving a vulnerable population should consider conducting routine testing as a best practice.

7

Document & Communicate All the Activities of Your Water Management Program

Documentation

Now that you have done all of the work required to create your water management program, write it down. This information will be important to improve your program and if you or others want to review your records. Your written program should include at least the following:

- Program team, including names, titles, contact information, and roles on the team
- Building description, including location, age, uses, and occupants and visitors
- Water system description, including general summary, uses of water, aerosol-generating devices (e.g., hot tubs, decorative fountains, cooling towers), and process flow diagrams
- Control measures, including points in the system where critical limits can be monitored and where control can be applied
- Confirmatory procedures, including verification steps to show that the program is being followed as written and validation to show that the program is effective
- Document collection and transport methods and which lab will perform the testing if environmental testing is conducted


Communication

You have worked hard to develop your water management program and you have carefully documented all aspects of it. Resist the temptation to put it on a shelf and walk away. Consider notifying building occupants that you have a plan in place to keep the building water systems safe, just as you would for an elevator inspection. Be sure to communicate with your employees and colleagues about your program on a regular basis and train those responsible for implementing and monitoring the program. Use this communication as an opportunity to identify strategies for improving the management and efficiency of your water systems.

Special Considerations for Healthcare Facilities

ELEMENTS OF A WATER MANAGEMENT PROGRAM

Developing and maintaining a water management program in healthcare facilities requires a few more considerations than the ones explained on [page 8](#). All healthcare facilities should have a *Legionella* water management program.

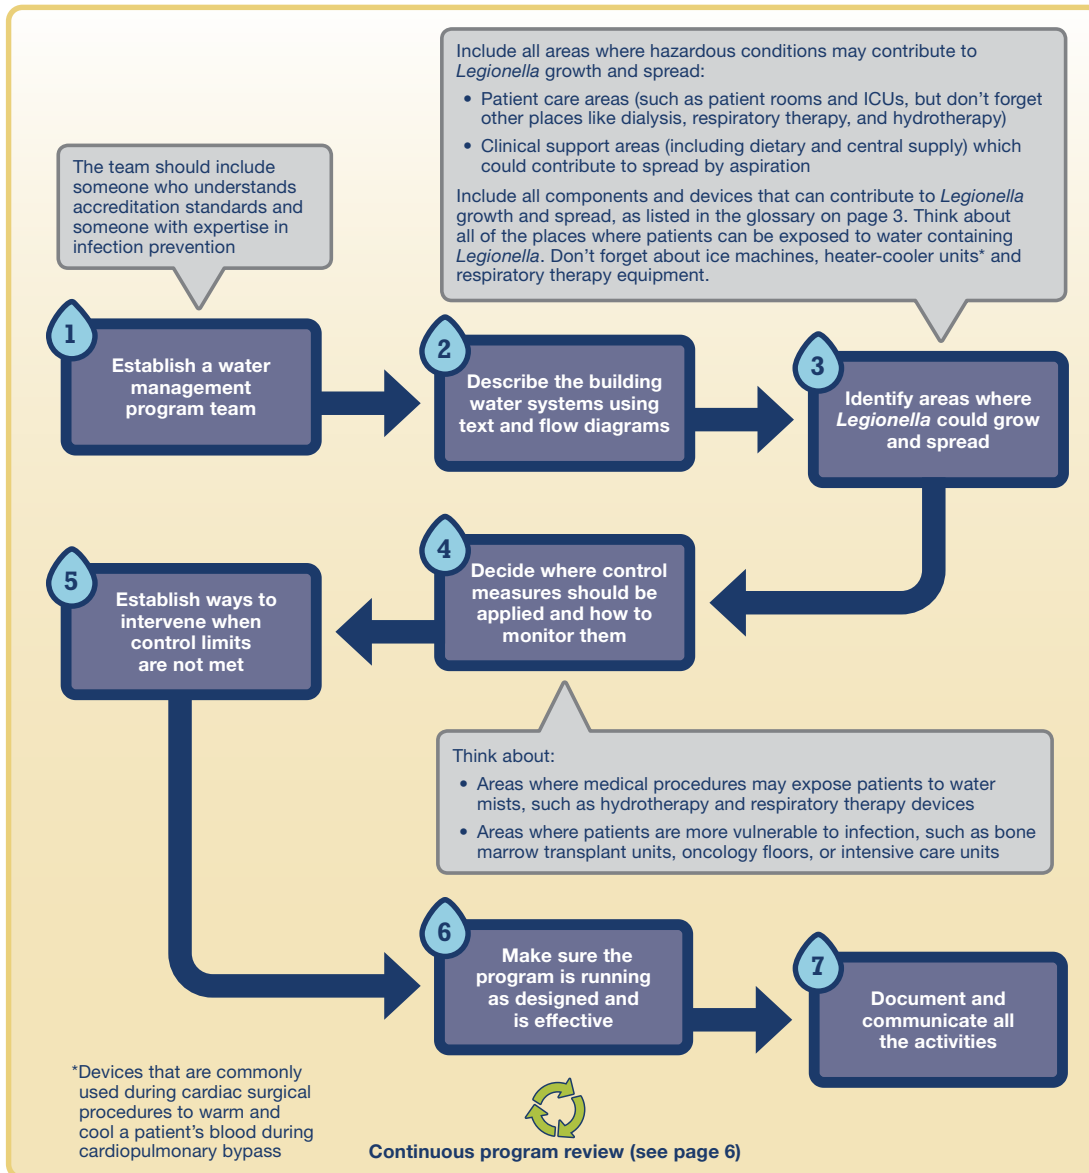

References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
 ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Note: ASHRAE 188 Normative Annex A applies to accredited healthcare facilities that have a Certification Board of Infection Control and Epidemiology (CBIC) certified infection preventionist or a master's-level epidemiologist.

IDENTIFYING & INVESTIGATING LEGIONNAIRES' DISEASE CASES


Healthcare facilities are often uniquely positioned to identify and respond to cases of Legionnaires' disease. A healthcare facility's water management program to limit *Legionella* growth and spread should include the actions to take when a patient is diagnosed with Legionnaires' disease or environmental triggers occur. If you decide to conduct a full investigation of the source of an infection, key elements should be included, as noted on the next page. A full investigation following a diagnosis of Legionnaires' disease can help determine whether the infection was acquired in the facility or the community.

Clinicians should test patients with healthcare-associated pneumonia (pneumonia with onset ≥ 48 hours after admission) for Legionnaires' disease. This is especially important among patients at increased risk for developing Legionnaires' disease (see [Appendix B](#)), among patients with severe pneumonia (particularly those requiring intensive care), or if any of the following are identified in your facility:

- Other patients with healthcare-associated Legionnaires' disease diagnosed in the past 12 months
- Positive environmental tests for *Legionella*
- Current changes in water quality that may lead to *Legionella* growth (e.g., low residual disinfectant levels, temperatures permissive to *Legionella* growth, nearby construction, areas of stagnation)

Other patients, besides those with healthcare-associated pneumonia, should also be tested for Legionnaires' disease (see [Appendix B](#)). The preferred diagnostic tests for Legionnaires' disease are molecular testing or culture of lower respiratory secretions on selective media and the *Legionella* urinary antigen test.

Legionnaires' disease symptoms

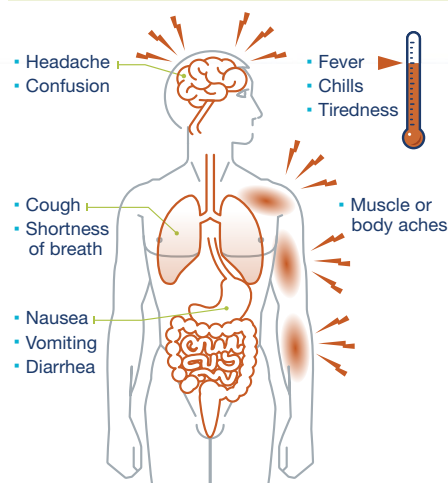

Symptoms usually begin 2 to 14 days after being exposed to *Legionella*.



Perform a full investigation for the source of *Legionella* when:

- **Presumptive healthcare-associated case:** ≥10 days of continuous stay at a healthcare facility during the 14 days before symptom onset. The case is considered a presumptive healthcare-associated case for surveillance purposes even if the stay involved multiple healthcare facilities.
- **Possible healthcare-associated case:** A portion of the 14 days before onset of symptoms spent in one or more healthcare facilities. These cases don't meet the criteria for presumptive healthcare-associated Legionnaires' disease.

Key elements of a full public health investigation include:

- Working with healthcare facility leaders*
- Performing a retrospective review of cases in the health department surveillance database to identify earlier cases with possible exposures to the healthcare facility
- Developing a line list of possible and presumptive cases associated with the healthcare facility
- Working with infection control and clinical staff to actively identify all new and recent patients with healthcare-associated pneumonia and test them for *Legionella* using molecular testing or culture of lower respiratory secretions on selective media and the *Legionella* urinary antigen test
- Obtaining postmortem specimens, when applicable
- Considering recommendations for restricting water in the facility or other immediate control measures, such as point of use microbial filters.
- Performing an environmental assessment to evaluate possible environmental exposures
- Performing environmental sampling, as indicated by the environmental assessment
- Remediating possible environmental source(s)
- Subtyping and comparing clinical and environmental isolates, if available
- Working with healthcare facility leaders to determine how long heightened disease surveillance and environmental sampling should continue to ensure the outbreak is over
- Working with healthcare facility leaders to review and possibly revise the water management program, if indicated

* Leaders may include infection control practitioners, facility managers, hospital administrators, quality assurance staff, or others.


References: ASHRAE 188: *Legionellosis: Risk Management for Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org
ASHRAE 12: *Managing the Risks of Legionellosis Associated with Building Water Systems*. ASHRAE: Atlanta. www.ashrae.org

Note: ASHRAE 188 Normative Annex A applies to accredited healthcare facilities that have a Certification Board of Infection Control and Epidemiology (CBIC) certified infection preventionist or a master's-level epidemiologist.

References & Resources

There are many references and resources that can help you develop and implement your *Legionella* water management program, some of which are listed below.

General



Standard 188—Legionellosis: Risk Management for Building Water Systems (ANSI Approved)

ASHRAE

Published 2015

store.accustech.com/ashrae/standards/ashrae-188-2021?product_id=2229689




Guideline 12—Managing the Risk of Legionellosis Associated with Building Water Systems

ASHRAE

Published 2000

store.accustech.com/ashrae/standards/guideline-12-2023-managing-the-risk-of-legionellosis-associated-with-building-water-systems?product_id=2568228




Legionellosis Guideline: Best Practices for Control of *Legionella*

Cooling Technology Institute

Published 2008

cti-marketplace.myshopify.com/products/gdl-59



Model Aquatic Health Code Guidance

Centers for Disease Control and Prevention

Published 2014

www.cdc.gov/model-aquatic-health-code/php/about/index.html

Laboratory Resources




ELITE Program

Centers for Disease Control and Prevention and Wisconsin State Laboratory of Hygiene

wwwn.cdc.gov/ELITE/Public/EliteHome.aspx



Planning Guides, Toolkits, and Trainings



Emergency Water Supply Planning Guide for Hospitals and Healthcare Facilities

Centers for Disease Control and Prevention, American Water Works Association

Published 2012, Updated 2019

www.cdc.gov/water-emergency/hcp/toolkit/index.html




Drinking Water Advisory Communication Toolbox

US Department of Health & Human Services, Centers for Disease Control and Prevention, Environmental Protection Agency, American Water Works Association

Published 2013, Updated 2016

www.cdc.gov/water-emergency/php/dwact



Toolkit for Controlling *Legionella* in Common Sources for Exposure

Centers for Disease Control and Prevention

www.cdc.gov/control-legionella/php/toolkit/control-toolkit.html



Prevent LD Training

Centers for Disease Control and Prevention, National Network of Public Health Institutes, University of Arizona Mel and Enid Zuckerman College of Public Health, Western Region Training Center at the University of Arizona

www.cdc.gov/control-legionella/php/training/index.html


Healthcare Resources



Federal Requirement to Reduce *Legionella* Risk Centers for Medicare & Medicaid Services

Published 2017

www.cdc.gov/control-legionella/php/healthcare/federal-requirement.html



Sehulster LM, Chinn RYW, Arduino MJ, Carpenter J, Donlan R, Ashford D, et al. **Guidelines for Environmental Infection Control in Health-care Facilities. Recommendations of CDC and the Healthcare Infection Control Practices Advisory Committee (HICPAC).** *MMWR*. 2003;52 (RR-10): 1–42.

www.cdc.gov/mmwr/preview/mmwrhtml/rr5210a1.htm



Kohn WG, Collins AS, Cleveland JL, Harte JA, Eklund KJ, Malvitz DM. **Guidelines for Infection Control in Dental Health-Care Settings—2003.** *MMWR*. 2003;52(RR-17):1–61.


www.cdc.gov/mmwr/preview/mmwrhtml/rr5217a1.htm





Tablan OC, Anderson LJ, Besser R, Bridges MD, Hajjeh R. **Guidelines for Preventing Health-care-associated Pneumonia, 2003: Recommendations of CDC and the Healthcare Infection Control Practices Advisory Committee.** *MMWR*. 2004;53(RR-3):1–36.

www.cdc.gov/mmwr/preview/mmwrhtml/rr5303a1.htm



Prevention of Healthcare-associated *Legionella* Disease and Scald Injury from Potable Water Distribution Systems

Veterans Health Administration

Published 2021, Amended 2024

www.va.gov/vhapublications/ViewPublication.asp?pub_ID=9181

Legionnaires' Disease Information



Legionnaires' Disease Website

Centers for Disease Control and Prevention

www.cdc.gov/legionella



Controlling *Legionella* Website

Centers for Disease Control and Prevention

www.cdc.gov/control-legionella




Investigating Legionnaires' Disease Website

Centers for Disease Control and Prevention

www.cdc.gov/investigate-legionella

Laws



Safe Drinking Water Act

Environmental Protection Agency

www.epa.gov/sdwa

Laws Literature Reviews



Technologies for *Legionella* Control in Premise Plumbing Systems

Environmental Protection Agency

www.epa.gov/ground-water-and-drinking-water/technologies-legionella-control-premise-plumbing-systems

Appendix A

www.cdc.gov/legionella/downloads/fs-legionnaires.pdf

LEGIONNAIRES' DISEASE

Legionnaires' (LEE-juh-nares) disease is a serious type of pneumonia (lung infection) caused by bacteria called *Legionella*. If you develop pneumonia symptoms and may have been exposed to *Legionella*, see a doctor right away. Be sure to mention if you have used a hot tub, spent any nights away from home, or stayed in a hospital in the last two weeks.

Legionnaires' Disease Can Cause Pneumonia Symptoms

Signs and symptoms of Legionnaires' disease can include:

- ▶ Cough
- ▶ Muscle aches
- ▶ Fever
- ▶ Shortness of breath
- ▶ Headache

Doctors use chest x-rays or physical exams to check for pneumonia. Your doctor may also order tests on a sample of urine and sputum (phlegm) to see if your lung infection is caused by *Legionella*.

Legionnaires' Disease Is Serious, but Can Be Treated with Antibiotics

Legionnaires' disease is treated with antibiotics. Most people who get sick need care in a hospital but make a full recovery. However, about 1 out of 10 people who get Legionnaires' disease will die from the infection.


Certain People Are at Increased Risk for Legionnaires' Disease

Most healthy people do not get Legionnaires' disease after being exposed to *Legionella*. Being 50 years or older or having certain risk factors can increase your chances of getting sick. These risk factors include:

- ▶ Being a current or former smoker
- ▶ Having chronic lung disease, such as emphysema or chronic obstructive pulmonary disease (COPD)
- ▶ Having a weakened immune system from diseases like cancer, diabetes, or kidney failure
- ▶ Taking medication that weakens your immune system

Legionella Usually Spreads through Water Droplets in the Air

In nature, *Legionella* lives in fresh water and rarely causes illness. In man-made settings, *Legionella* can grow if water is not properly maintained. These man-made water sources become a health problem when small droplets of water that contain the bacteria get into the air and people breathe them in. In rare cases, someone breathes in *Legionella* while they are drinking water and it "goes down the wrong pipe" into the lungs. You can't catch Legionnaires' disease from someone else. You also can't get someone else sick if you have it.

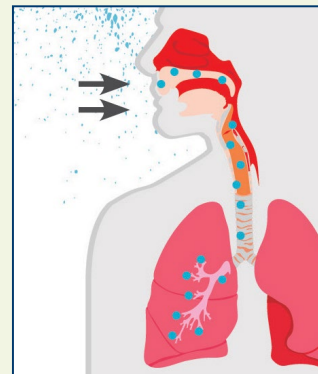

Legionnaires' disease, a type of severe pneumonia, is caused by breathing in small droplets of water that contain *Legionella*.

Common Sources of Infection

Outbreaks of Legionnaires' disease are often associated with large or complex water systems, like those found in hospitals, hotels, and cruise ships.

The most likely sources of infection include:

-  Water used for showering (potable water)
-  Cooling towers (parts of large air conditioning systems)
-  Decorative fountains
-  Hot tubs

Appendix B

www.cdc.gov/legionella/downloads/fs-legionella-clinicians.pdf

What Clinicians Need to Know about

LEGIONNAIRES' DISEASE

Legionnaires' disease is a sometimes fatal form of pneumonia that is on the rise in the United States. Unfortunately, this disease is also underrecognized and underdiagnosed. Clinicians are in a unique position to make sure cases are detected, allowing rapid investigation by public health officials and prevention of additional cases.

Diagnosis and Testing

Clinical features of Legionnaires' disease include cough, fever, and radiographic pneumonia. Signs and symptoms for Legionnaires' disease are similar to pneumonia caused by other pathogens; the only way to tell if a pneumonia patient has Legionnaires' disease is by getting a specific diagnostic test. Indications that warrant testing include:

- Patients who have failed outpatient antibiotic therapy for community-acquired pneumonia
- Patients with severe pneumonia, in particular those requiring intensive care
- Immunocompromised patients with pneumonia*
- Patients with a travel history (patients who have traveled away from their home within 14 days before the onset of illness)
- All patients with pneumonia in the setting of a Legionnaires' disease outbreak
- Patients at risk for Legionnaires' disease with healthcare-associated pneumonia (pneumonia with onset ≥ 48 hours after admission)

* Clinicians may also consider testing for Legionnaires' disease in patients with other risk factors for this infection (see page 2).

Testing for healthcare-associated Legionnaires' disease is especially important if any of the following are identified in your facility:


- Other patients with healthcare-associated Legionnaires' disease diagnosed in the past 12 months
- Positive environmental tests for *Legionella*
- Current changes in water quality that may lead to *Legionella* growth (such as low chlorine levels)

Infection control staff may have more information about these situations in your facility.

The preferred diagnostic tests for Legionnaires' disease are molecular testing or culture of lower respiratory secretions (e.g., sputum, bronchoalveolar lavage) on selective media and the *Legionella* urinary antigen test. Serological assays can be nonspecific and are not recommended in most situations. Best practice is to obtain both molecular testing or culture of sputum and a urinary antigen test concurrently. Sputum should ideally be obtained prior to antibiotic administration, but antibiotic treatment should not be delayed to facilitate this process. The urinary antigen test can detect *Legionella* infections in some cases for days to weeks after treatment. The urinary antigen test detects *Legionella pneumophila* serogroup 1, the most common cause of Legionnaires' disease; isolation of *Legionella* by molecular test or culture is important for detection of other species and serogroups and for public health investigation. Molecular techniques can be used to compare clinical isolates to environmental isolates and confirm the outbreak source.

Order both a molecular test or culture of a lower respiratory specimen and a urinary antigen test when testing patients for *Legionella*.

Legionnaires' disease in the United States, 2000-2022

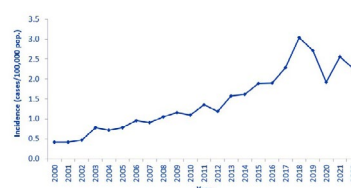

In the United States, reported cases of Legionnaires' disease have grown by nearly nine times since 2000. Nearly 10,000 cases of Legionnaires' disease were reported in 2018, but this number is likely an underestimate as the illness is thought to be underdiagnosed.

More illness occurs in the summer and early fall, but Legionnaires' disease can happen any time of year.



Treatment

If your patient has Legionnaires' disease, see the most recent guidelines for treatment of community-acquired pneumonia (<http://bit.ly/CommunityPneumonia>) and hospital-acquired pneumonia (<http://bit.ly/HospitalPneumonia>). Macrolides and respiratory fluoroquinolones are currently the preferred agents for treating Legionnaires' disease.

Reporting

Make sure your infection control department or lab are promptly reporting cases of Legionnaires' disease to your local health department. Timely identification and reporting of cases is important, as this allows public health officials to quickly identify and stop potential clusters and outbreaks by linking new cases to previously reported ones.

Etiology

Legionnaires' disease is a severe form of pneumonia that often requires hospitalization and is fatal in about 10% of cases overall, and in 25% of healthcare-associated cases. Legionnaires' disease is caused by *Legionella* bacteria. There are at least 60 different species of *Legionella*, and most are considered capable of causing disease. However, most disease is caused by *L. pneumophila*, particularly serogroup 1.

Transmission

While *Legionella* is found in natural, freshwater environments, it can become a health concern in human-made water systems (e.g., plumbing system of large buildings, cooling towers, certain medical devices, decorative fountains, hot tubs) where conditions allow it to multiply and come in contact with vulnerable persons. People contract *Legionella* by inhaling aerosolized water droplets containing the bacteria, or, less commonly, by aspiration of drinking water containing *Legionella*. *Legionella* is usually not transmitted from person to person; however, a single episode of person-to-person transmission has been reported. Fortunately, most people exposed to the bacteria do not become ill.

Risk Factors

Risk factors for developing Legionnaires' disease include:

- Age ≥50 years
- Smoking (current or historical)
- Chronic lung disease, such as emphysema or COPD
- Immune system disorders due to disease or medication
- Systemic malignancy
- Underlying illness, such as diabetes, renal failure, or hepatic failure

Prevention

The key to preventing Legionnaires' disease is maintenance of the water systems in which *Legionella* may grow. If *Legionella* is found in a healthcare facility's water system, the facility should work to eliminate the bacteria. CDC encourages all building owners, and especially those in healthcare facilities, to develop comprehensive water management programs to reduce the risk of *Legionella* growth and spread. Learn more about how to develop a water management program at www.cdc.gov/control-legionella/php/toolkit/wmp-toolkit.html.

cdc.gov/legionella | CS315179-C 08/06/2025

Timely reporting of Legionnaires' disease cases is important for controlling clusters and outbreaks.

Common Sources of Infection

Outbreaks of Legionnaires' disease are most often associated with large or complex water systems, like those found in hospitals, long-term care facilities, hotels, and cruise ships.

The most likely sources of infection include:



Water used for showering (potable water)



Cooling towers (parts of large air conditioning systems)



Decorative fountains



Hot tubs



Notes

A large rectangular area for taking notes, defined by a vertical line on the left and horizontal lines across the page.





