



Deficiencies Assigned to Drinking Water Outbreaks and Outbreak-related Cases — Waterborne Disease and Outbreak Surveillance System, 2013–2014

Outbreaks (N=42)

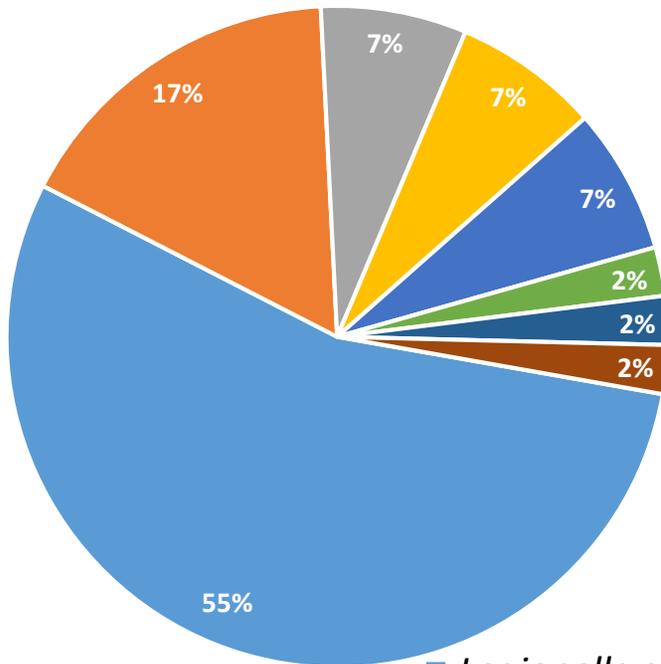

Cases (N=1,006)

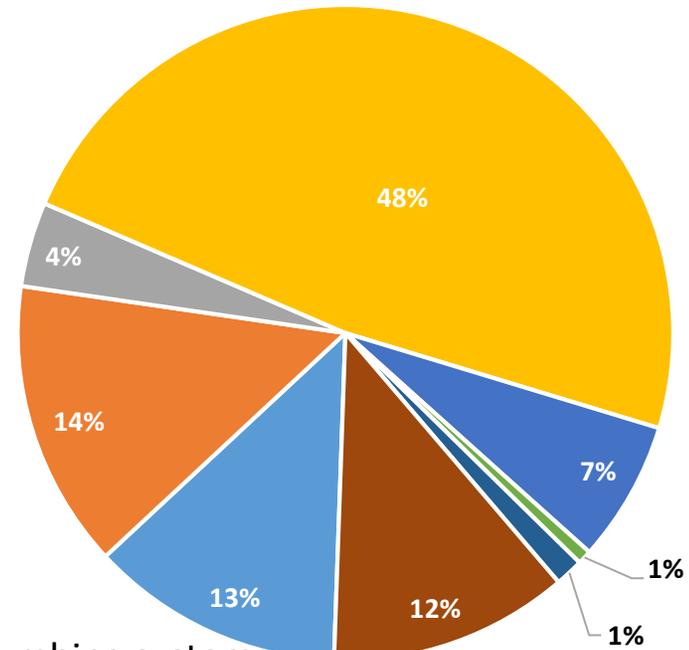

- Legionella spp. in premise plumbing system
- Unknown/Insufficient information
- Multiple
- Treatment not expected to remove contaminant
- Untreated ground water
- Distribution system
- Premise plumbing system
- Treatment Deficiency

